


FLOOR DOOR


| Side B | Side C | Side D | VERSION | H LIGHT | H FRAME | FRAME | WINDOW | GLASS | ACCESSORIES |
|--------|--------|--------|---------------------------------|---------|---------|-------------------------|-----------|-------------|-------------|
| | G 1 | | Standard covering: Inox BA mecc | 2000 | 2100 | Covering: Inox BA mecc. | Panoramic | Transparent | C2 |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |

C1 = Enabling key for the floor button pad (single insertion) C2 = Enabling key for the floor button pad (double insertion) PM = Button pad on the wall PE = Outside lock and button pad

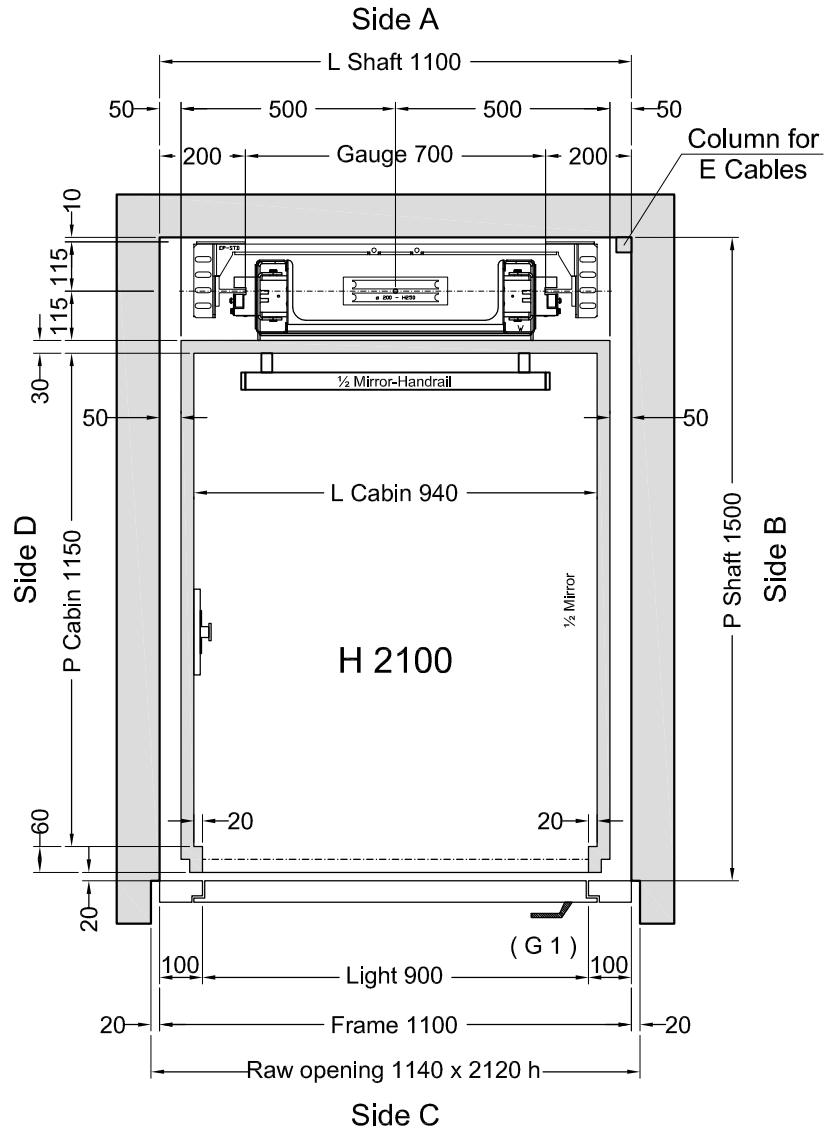

| | | | | | |
|--|--|--|--|--|--|
| | | | | | |
| | | | | | |
| | | | | | |
| | | | | | |



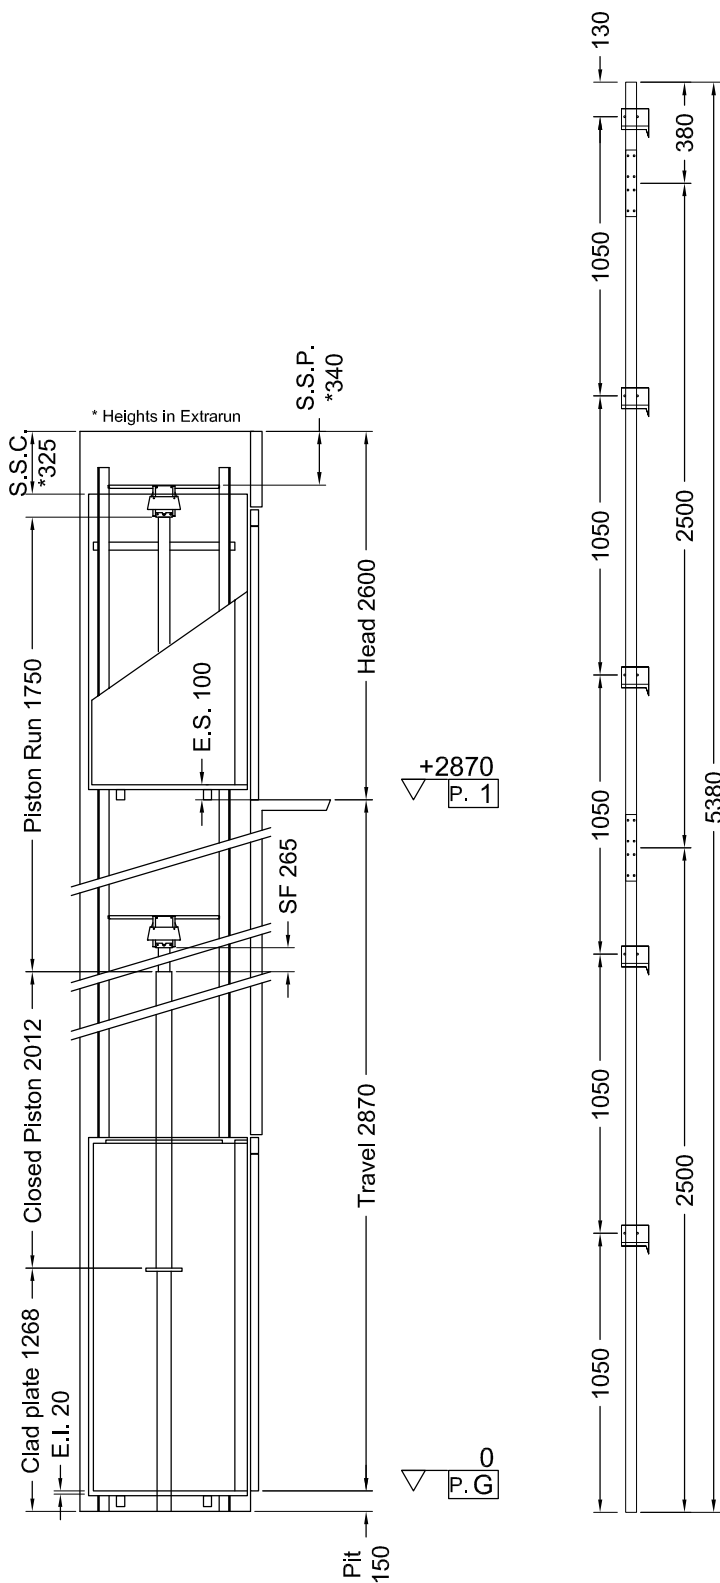

| | | | |
|--|--|---|----------------------------|
| Indirect Installation | | Speed 0,3 m/s | 29/07/15 16.26 (V.2852) |
| THRUST DURING NORMAL OPERATION | | THRUST OF SAFETY DEVICE INTERVENT. | |
| P | (N) 10467 | P | (N) 481 |
| N | (N) 533 | N | (N) 7030 |
| F1 | (N) 1499 | F1 | (N) 2498 |
| F2 | (N) 208 | F2 | (N) 347 |
| SPACES | | PRESSURES | |
| E.I. | Extrarun below cabin (mm) 20 | Max static pressure | (bar) 35,17 |
| E.S. | Extrarun above cabin (mm) 100 | Min static pressure | (bar) 19,87 |
| SF. | Piston extraction (mm) 265 | Overpressure limit | (bar) 49,23 |
| S.S.P. | Piston/head (mm) 340 | Residual pressure | (bar) 1,25 |
| S.S.C. | Cabin/head (mm) 325 | | |
| HYDRAULIC UNIT | | MECHANICAL PARTS | |
| Central unit | GMV HL 3010 (-*) | | |
| Capacity (l/min) | 35 | Guide rails | 70x70x9 |
| Motor (V) | TF400V | Brackets | (Nr) 5 |
| Power (Kw) | 2,9 | Ropes | Ø 9 mm 6-(1+9+9) |
| Nominal current (A) | 11 | Cables length (mm) 2 x | 8000 |
| Piston | Start Home (Ø) 70x5x1750 | Min actual breaking load (N) | 47300 |
| Opt. oil position | BASSO | | |
| Tubing | 3/4" EN 853 1SN - FD 3/4" - GOMITO 3/4" | | |
| Tubing length (mm) | 6000 | | |
| Min hydraulic oil (L) | 39 | | |
| SECURITY DEVICES | Manufacturer | Model | Certificate |
| Safety Gear | PFB | BP1 | TÜV AFV515 |
| Block Valve | START ELEVATOR | 1/2" 0327 | CA50.00525 |
| Key Locks | Prudhomme | PLT/L/CPX NL 11-400-1002-125-02 | |
| MACHINERY LOCATION | | | |
| At floor | G | Length of the hose travel | 2000 (mm) |
| Cables enter in shaft: Side | A | | |
| CABIN | CABIN ACCESSORIES | | |
| Panels | ** | ½ Mirror | Side A, B |
| Finishes | Inox BA mecc. | Handrail | Inox Lucido, Side A |
| Oper. panel | VERTICAL (Like finishes) | Outside covering | Roof |
| Floor | By Customer | Outside finishing | Griglo PPS1 |
| Ceiling | DAMA Led Strips - Griglo PPS1 | | |
| <i>(**) Side A & B Griglo PPS1 - Side D Arpa 0509 VG Luc</i> | | | |
| OTHER ACCESSORIES | | | |
| Enabling key for the cabin button pad, double insertion | | | |
| Guides dimension 2.5 m | | | |
| Manual pump | | | |
| Manostat with overweight signal | | | |
| Two speed | | | |
| Handles CASPIM (Long) | | | |
| Telephone by Lift Shop | | | |
| Full height Infra-red curtain V2 | | | |
| Power supply 400V | | | |
| Car Operating Panel Side D | | | |
| Roof covering | | | |
| Automatic Control 2011 | | | |
| Cabin Buttons: G 1 | | | |
| Call Accept | | | |
| Emergency manual descent from cabin | | | |

